

Minimization of Real Power Losses with FACTS with the Application Hybrid MGA and IGWO Optimization Techniques

J. Sutter, J. Nderu, A. Mutegi

The School of Electrical, Electronic and Information Engineering (SEEIE),
Jomo Kenyatta University of Agriculture and Technology, Nairobi, Kenya

Abstract- This paper work presents a novel individual and Hybrid MGA and IGWO was utilized to develop FACTS-controlled optimization model for reduction of reactive power losses. The algorithm simultaneously solved the objective problem and tunes as it searches for FACTS location and sizes. Objective function constrained optimal power flow (CPF) with FACTS devices for TTC within real and reactive power generation limits, voltage limits, line flow limits, and FACTS devices operation limits. Thyristor-Controlled Series Capacitor (TCSC) parameters has been optimized for the research and the work has been successfully carried on MATLAB platform using IEEE 30-bus test bus systems. Power system processes and parameters can be optimized using artificial intelligence techniques like artificial neural networks and genetic algorithm alongside power electronics based Flexible AC Transmission Systems (FACTS) devices. FACTS normalize voltage or control the power that is either added into or absorbed from the system. They enhance the overall grid capacity and performance. They also increase the dependability and efficiency of power systems. Apart from alleviating power transients, FACTS provide greater system real losses control in interconnected power systems

Keywords- Algorithms, FACTS, Power system parameters Optimization, Reactive power, Losses, Reactive control

I. INTRODUCTION

Currently, electrical energy utilities run on constraints of complex interconnectivity and operation limits therefore forcing them to operate their existing infrastructure at a higher effectiveness. There is an interest in better utilization of the existing power systems to control power flow, improve system dynamics, and increase system reliability by using Flexible AC Transmission Systems (FACTS). Besides, FACTS devices can be used to increase power system transfer capability [1]. Wide variety of algorithms have been

developed for calculating TTC, boosting voltage profiles, minimizing generation costs and loss reduction. Optimization of system parameters can be implemented by techniques such as sequential quadratic programming (SQP), Genetic Algorithm, Artificial Bee Colony Algorithm, Particle Swarm optimization and transfer based security constrained optimal power flow (TSCOPF) method. These methods require an objective function to get the optimal solution. [2]. Under constantly increased electricity demands, it is becoming more critical to boost the system capability such that more power transfers, maintenance of voltage

stability margins and losses are minimized with less network expansion investment. In the place of building new supply substations or lines, proper installation and optimization, with Artificial Intelligence (AI), of transmission as well as generation units can make power networks billet more from source end to load [3]. With application of optimized FACTS devices, the power can be flown through the chosen routes with consideration on an increase in transmission line capability and improvement for the security of power system. UPFC, for instance, is very versatile FACTS controllers [4]. Enhancement of total transfer capability, minimization of power losses and improvement of voltage profiles in overloaded transmission network ensures that the system is stable and efficient even under stressed conditions. AI methods like genetic algorithm, fuzzy-logic, artificial bee colony algorithm and particle swarm optimization are applied to determine the optimum ratings of FACTS devices for simultaneous minimization of power loss and voltage profile enhancement, improved line flows and loss therefore boosting of available power transfers.

II. METHODOLOGY

1. Problem Formulation

The problem will be formulated to form the maximization the viable TTC while making observation on voltage profiles and system loss reduction. The optimization problem can be augmented simultaneously subject to the various equality and inequality constraints. The objectives minimization of voltage stability index, generation cost, real power loss and maximization the power that can be transferred from a generators source area to loads in a sink area. The formulation will cover the TTC base case (without FACTS controllers), TTC with UPFC and TTC with TCSC. TTC is the maximum power transfer without any line thermal overload, violation of voltage limits voltage instability or transient instability; the core constituent of the ATC. It reliant on system base case operating conditions, system operating limits, configuration of the system network, network contingencies among other constraints. TTC can be accomplished using Repeated Power Flow,

Continuation Power Flow and Security Constrained Power Flow. The Security Constrained Power Flow has been utilized for this study.

2. Base case CPF (without FACTS controllers)

To determine TTC, the objective is to maximize the power transfer between two areas without any violation of thermal, voltage and stability limits. A standard TTC problem formulation can be written as shown in the following equation: -

$$P_r = \sum_{k=1}^{ND_{SNK}} P_{Di} \quad (1)$$

The above is subject to: -

$$P_{Gi} - P_{Di} + V_i V_j V_{ij} \cos(\theta_{ij} + \delta_i - \delta_j) = 0 \quad (2)$$

$$Q_{Gi} - Q_{Di} + V_i V_j Y_{ij} \sin(\theta_{ij} - \delta_i + \delta_j) = 0 \quad (3)$$

$$\begin{aligned} P_{Gi}^{min} &\leq P_{Gi} \leq P_{Gi}^{max} \\ Q_{Gi}^{min} &\leq Q_{Gi} \leq Q_{Gi}^{max} \end{aligned} \quad (4)$$

$$S_{ij} \leq S_{ij,max} \quad (5)$$

$$V_i^{min} \leq V_i \leq V_i^{max} \quad (6)$$

Where: ND_SNK: Number of load buses in the sink area and P_{Di} is the real load at bus i. The other equations are the power flow constraints and the following equations represent real and reactive power generation bounds, the second last equation stands for the thermal limitations and the last equation denotes the voltage level constraint.

3. CPF with TCSC FACTS Controller

The modified TTC function with TCSC FACTS controller, P_r for maximizing the TTC [44] of power transactions between source and sink areas in power system is given as:

$$P_r = \sum_{k=1}^{ND_{SNK}} P_{Di} \quad (7)$$

Where: ND_SNK: Number of load buses in the sink area and P_{Di} : Real load at bus i

This is subject to the constraints below which are simply the real and reactive power balance equations with TCS FACTS controller at all the bus

bars. The equality constraints with TCSC controller are formulated as follows: -

$$P_{Gi} - P_{Di} + \sum_{k=1}^m P_{Pi}(\alpha_{Pk}) + V_j Y_{ij}(X_S) \cos(\theta_{ij}(X_S) - \delta_j + \delta_i) = 0 \quad (8)$$

$$Q_{Gi} - Q_{Di} + \sum_{k=1}^m Q_{Pi}(\alpha_{Pk}) + V_j Y_{ij}(X_S) \sin(\theta_{ij}(X_S) - \delta_j + \delta_i) = 0 \quad (9)$$

$$P_{Gi}^{min} \leq P_{Gi} \leq P_{Gi}^{max} \quad (10)$$

$$Q_{Gi}^{min} \leq Q_{Gi} \leq Q_{Gi}^{max} \quad (11)$$

$$V_i^{min} \leq V_i \leq V_i^{max} \quad (12)$$

$$T_i^{min} \leq T_i \leq T_i^{max} \quad (13)$$

$$0 \leq X_{Si} \leq X_{Si}^{max} \quad (14)$$

$$\alpha_{Pi}^{min} \leq \alpha_{Pi} \leq \alpha_{Pi}^{max} \quad (15)$$

$$0 \leq V_{Ui} \leq V_{Ui}^{max} \quad (16)$$

$$-\pi \leq \alpha_{Ui} \leq \pi \quad (17)$$

$$Q_{vi}^{min} \leq Q_{vi} \leq Q_{vi}^{max} \quad (18)$$

Where:

- P_{Gi} and Q_{Gi} are real and reactive power generation at bus i
- P_{Di} and Q_{Di} are real and reactive loads at bus i
- $P_{Pi}(\alpha_{Pk})$ and $Q_{Pi}(\alpha_{Pk})$ are the injected real and reactive power of TCSC at bus i
- V_i and V_j are voltage magnitude at buses i and j
- $Y_{ij}(X_S)$ and $\theta_{ij}(X_S)$ are the magnitude and angle the ij th element in admittance matrix with TCSC
- δ_i and δ_j are the voltage angles at bus i and j
- P_{Gi}^{min} and P_{Gi}^{max} are lower and upper limits of real power generated at bus i
- V_i^{min} and V_i^{max} are lower and upper limits of real voltage magnitude at bus i
- T_i^{min} and T_i^{max} are the minimum and maximum range of tap changing transformer
- X_S is the vector reactance of TCSC
- N is the total number of buses
- NG is the number of generators.

- NL is the number of branches, and
- ND_SNK is the number of load buses in sink area.

4. Proposed Optimization Techniques Modified Genetic Algorithm

The Modified GA is a stochastically population-based technique introduced by Storm and Price in 1997. MGA belongs to the family of genetic algorithms (GA). MGA performs just like a GA and it has the following operation: initialization, mutation, crossover, and selection. In MGA, individuals are abridged to a chromosome that programs the control variables of the problem. The strength of an individual is the objective function (fitness) that must be optimized. A random s function might produce the initial population size. After the start, consecutive populations are generated using the GA iteration process, which encompasses three basic functional operators: reproduction, crossover and mutation. Lastly, the population stabilizes, because no better individual can be found. When algorithm converges, and most of the individuals in the population are almost identical, it represents a sub-optimal solution. These parameters are vital to determine the optimization properties of the algorithm. To apply MGA to solve a specific problem, one has to define the solution representation and the coding of control variables. The optimization problem here is to use Constrained Power Flow (CPF) to find the Total Transfer Capability for various MGA-tuned FACTS devices to determine optimal locations and compensation sizes. The basic operation of MGA is stated as follows: -

Initialization

The initialization procedure will select the initial population within the range of the control variables with a random number generator. The user can postulate the population number in this procedure.

Selection

This is a key reproduction process in which individual chromosomes are derived according to their objective function (fitness); it is an artificial operation that mimics the version of the Darwinian procedure of natural selection. The first stage of the

reproduction process is to select chromosomes for coupling. The roulette wheel selection is applied here. It is seen that stochastic universal sampling exhibits better convergence.

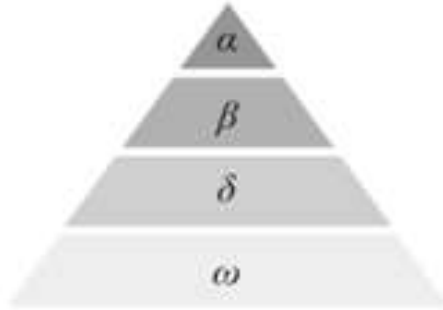


Figure 1: Grey wolf pack ranking

Crossover

Crossover is one of the key characteristics of GA that make them dissimilar from other algorithms. Its focal objective is to recombine blocks on diverse individuals to make a new block of generations as shown in the equations below: -

$$x^1 = \mu_1 x + \mu_2 y \quad (19)$$

$$y^1 = \mu_1 y + \mu_2 x \quad (20)$$

$$\mu_1 + \mu_2 = 1, \mu_1 \mu_2 > 0 \quad (21)$$

where x, y are the two parents, x', y' are their two descendants. μ_1 is obtained by a uniform arbitrary number generator between the range (0~1).

Mutation

Mutation is used to present some sort of artificial divergence in the population to avoid untimely convergence to local optimum. An arithmetic mutation operation that has demonstrated positive result in a number of studies is dynamic or non-uniform mutation is designed for fine-tuning aimed at achieving a high degree of accuracy. For a given parent x , if the gene x_k is selected for mutation, then the resulting gene is selected with equal probability from the two selections: -

$$x_k^1 = x_k + r(b_k - x_k) \left(1 - \frac{t}{T}\right)^b \quad (22)$$

$$x_k^1 = x_k - r(x_k - a_k) \left(1 - \frac{t}{T}\right)^b \quad (23)$$

Where r is a uniform arbitrary number selected between the range (0,1), t is the existing generation number, T is the maximum number of generations and b is a parameter determining the degree of lack of consistency. The amount of mutation reduces as the number of generations increases.

Replacement of Population

Two population replacement methods, non-overlapping generations and steady-state replacement. When using non-overlapping generations, a generation was entirely replaced by its progeny created through selection, crossover and mutation. It is conceivable for the offspring to be worse than their parents and some fitter chromosomes may be lost from the evolutionary process. Steady-state replacement is used to go over this problem. In this course, a number of offspring are created and these replace the same number of the least fit individuals in the population hence providing better convergence.

Improved Grey Wolf Optimization (IGWO) Algorithm

IGWO a new swarm intelligence algorithm based on the firmly organized scheme and hunting behavior of grey wolves, which includes three parts: tracking prey, surrounding prey, attacking prey, and other optimization processes. Its summarized as follows: -

Wolf ranking Hierarchy

Grey wolves mainly animate in groups, and the cluster follows the social pecking order, as shown in figure shown above. It can be seen from the figure that the α Wolf is the leader of the social group and is mainly accountable for making decisions about actions such as predation, while the rest of the wolves obey the command of the α Wolf. Level 2: β Wolf, submitting and supplementary to the α Wolf, can control all the wolves except for α Wolf. Level 3: δ Wolf, obeying the arrangement of α and β Wolf at the same time, can rule the rest of the residual wolf pack, and rank ω is the lowermost level. The general predation behavior of grey wolves is led by α wolves, and the task of other wolves is to surround the prey.

Surrounding prey

Grey wolves surround their prey as they hunt. The mathematical model of encircling prey is as follows:

-

$$D = |C \cdot X_p(t) - X(t)| \quad (24)$$

where $X(t)$ represents the position of grey wolves, and X_p represents the position vector of prey:

$$X(t+1) = X_p - A \cdot D \quad (25)$$

where A and C represent coefficient vectors, and the calculation formula is as follows:

$$A = 2a \cdot (r_1 - 1) \quad (26)$$

$$C = 2r \cdot t \quad (27)$$

where t denotes the current number of iterations, and $a = 2(1 - t/T_{\max})$ denotes that the variable reduces linearly from 2 to 0, $r_1, r_2 \in [0,1]$ during the iteration process.

Hunting Prey

Grey wolves can identify prey and surround it. The search process is α Wolf commands and leads, β and δ sometimes, they will take part in hunting. Hypothesis α , β and δ . The wolf can have a deeper understanding of the potential location of prey, and accordingly, during the algorithm iteration process, save the best location of the three wolves in the current population, and mark them as α , β and δ . Then, according to the position of the three parameters ω Wolf individuals are updated, and the mathematical model is thus developed.

Hybrid MGA and IGWO Algorithm

The IGWO algorithm has been successfully applied in the fields of job shop scheduling, power system analysis, economic forecasting, etc. Yet, like other algorithms, the IGWO is prone to fall into the local optimum and has a very slow convergence speed. Therefore, in order to improve the global convergence and convergence speed, this research has utilized MGA. GWO's searching ability is based on two principles: exploration and exploitation. Exploration refers to the process of exploring new areas or mathematically, the process of looking for

a solution as much as possible in a search space to prevent local optimum stagnation. On the other hand, exploitation refers to looking in the same direction in greater depth or mathematically, searching for a solution with high precision. Using the GWO algorithm to find the global optimum with high efficiency necessitates achieving the proper balance between exploration and exploitation. As compared to other swarm intelligent techniques, GWO algorithms perform well in finding the global optimum for the high-dimensional problem, but not so well in finding the global optimum for low-dimensional problems. Normal there is no guarantee that GWO will identify global minima, it is conceivable that it will stick with local minima and calculate corresponding angles that do not eliminate the third harmonic.

To mitigate this issue, a donor vector from a MGA like the differential evolution technique is used, which adds randomness to the GWO technique and allows it to escape out of the local optimum and look in a new direction for the global optimum. Since the DE technique is based on accomplish random initialization, it outdoes finding the global optima, but it has a limitation in that it lacks a parameter that is directly related to algorithm convergence, so the speed of convergence is very slow and provides power oscillation around the global optima. As a result, the flaw in one approach is offset by another method. Therefore, a new algorithm called improved gray wolf optimization and differential evolution (IGWO-MGA) is proposed in this thesis, which combines the IGWO algorithm with a better convergence factor and the DE algorithm with a dynamic scaling factor with the help of a DE crossover operator. The initialization of a arbitrary vector of population size " N_p " with dimension " d " under boundary conditions is the first step in the IGWO-MGA method. Where ' d ' denotes the problem dimension or the number of variables in the problem, and this random vector is referred to as the target vector, which can be described as shown below:-

$$|X_i^t| = (x_{i,1}^t, x_{i,2}^t, x_{i,3}^t, \dots, x_{i,d}^t) \quad (28)$$

where $i \in \{1, 2, 3 \dots N_p\}$, and t is the current value of iteration and each individual can be calculated as follows:

$$x_{i,j} = x_{l,b} + \text{rand}(0,1) * (x_{ub} - x_{lb}) \quad (29)$$

where x_{ub} , x_{lb} are the upper bound and lower bound vectors with d individuals respectively. The same way as in IGWO, the three best results in IGWO-MGA are kept as alpha ($X \rightarrow \alpha$), beta ($X \rightarrow \beta$), and delta ($X \rightarrow \delta$) solutions from the target vector. Succeeding the saving of the results, the target vector is exposed to a mutation in a manner like the MGA technique. In the suggested algorithm, the donor vector $V \rightarrow it$ is generated from the target vector $X \rightarrow it$ using a DE/best/1 mutation approach with a dynamic scaling factor F' , which offers more arbitrariness in the initial stages, preventing the algorithm from dropping into a local optimum, while the value of F' decreases in the final stages, boosting the algorithm's convergence speed. So, the donor vector can be stated as follows: -

$$|V_i^t| = |X_{alpha}^t| + F' * (|X_{R1}| - |X_{R2}|) \quad (30)$$

where X_{alpha} , t is the α solution or best solution as far and X_{R1} , X_{R2} are the randomly selected solution from the target vector and F' can be expressed as follows:

$$F' = \frac{2}{1 + e^{(k * (\frac{t}{t_{max}}))}}; k \in \quad (31)$$

IGWO's searching ability is primarily determined by the vectors A and C , where C is a randomly generated vector ranging from 0 to 2, the wolves favor exploration if $C > 1$ and exploitation if $C < 1$, and C plays no role in IGWO's convergence speed. Now, the only vector that is important in convergence is A , but the value of A is determined by the convergence factor or a , and the value of a decreases linearly from 2 to 0 over the course of iteration. We need to adjust the convergence factor to enhance the speed of the algorithm as shown in the equation below: -

$$F' = \frac{2}{1 + e^{(k * (\frac{t}{t_{max}} - \frac{1}{2}))}}; k \in \quad (32)$$

Using this better convergence factor, the improved placement of the wolves can be calculated on the foundation of the position of the greatest wolves. Let us consider the i^{th} position vector of wolves in the t^{th} iteration as $W_i^t = [w_{i,2}^t, w_{i,2}^t \dots w_{i,d}^t]$ which can be calculated using equation. The two vectors are combined using a binomial crossover operator to generate a position vector for the next iteration. The new location vector can be defined as follows:

$$X_{i,j}^{t+1} = \begin{cases} V_{i,j}^t & \text{if } \text{rand}(0,1) \leq CR \text{ OR } j = \delta \\ X_{i,j}^t & \text{if } \text{rand}(0,1) > CR \text{ AND } j \neq \delta \end{cases} \quad (33)$$

5. Research Procedure

The objectives of this will be realized as follows:

- An objective function based (base case, without FACTS) for maximization total transfer capability as the optimization problem will be formulated and solution derived
- Singular Modified Genetic Algorithm and Improved Grey Wolf Optimization to solve the objective function, separately, via optimal location and sizing of FACTS devices will be developed
- Hybrid Genetic Algorithm and Improved Grey Wolf Optimizer Algorithm will be developed and used to solve the function for maximizing power transfer capability while observing the voltage profiles and loss reduction
- Hybrid Improved Grey Wolf Optimizer Algorithm and Genetic Algorithm with FACTS model above will be utilized to carry out simulations and evaluate effectiveness of model on improvement of power transfer capability
- The results will be assessed and effects of individual FACTS devices compared to each other for the four system parameters under consideration.

The proposed test networks will be the standard

Parameter	Values
Reactance TCSC (p.u.)	0 and 0.02
Location TCSC (Line)	40 and 4

IEEE 30 bus test system

Simulation will be carried out in MATLAB

III. RESULTS AND DISCUSSION

1. Results from the Optimal Power Flow (Base Case, Without Optimized Facts)

Table shows the optimal load flow result, the total real power loss is 17.53MW, reactive power losses (20.92MVAR), TTC (240.26MW) and total system load of 283.4MW for the power flow without optimized FACTS. The power flows from send end bus to receiving buses are generally with limits apart from power flow from bus 1 to bus 2.

Table 1

Optimal Power flow Solution by Newton Raphson	
Power-Loss (MW)	17.53
Reactive-Loss (MVAR)	20.92
Total System Load (MW)	283.4
Total Transfer Capability (MW)	240.26

2. OPF with GA-tuned UPFC

Optimization Results

The optimized values for GA-tuned UPFC are indicated in the table 2 below: -

Table 2

Parameter	Values
Voltage UPFC (PU) :	1.01 and 1.03
Angle UPFC (R) :	-0.01 and 0.54
Location UPFC (Bus) :	Bus 1 and Bus 8

Optimal NR Load flow Solution with GA-tuned UPFC

Table 3 shows the optimal load flow result; the reactive power losses are 15.29MVAR. The power flows from send end bus to receiving buses are generally with limits apart from power flow from bus 1 to bus 2 where the loss load has reduced to 41.735MW from 43.143MW (a difference of 1.408MW).

Table 3: Newton Raphson Load flow Solution
Newton Raphson Load flow Solution

Newton Raphson Load flow Solution	
Power-Loss (MW)	16.75
Reactive-Loss (MVAR)	15.29
Total System Load (MW) :	283.4
Total Transfer Capability (MW)	241.66

3. OPF with GA-tuned TCSC

Optimization Results

The optimized values for MGA-tuned TCSC are indicated in the table below: -

Optimal NR Load flow Solution for GA-tuned TCSC

Table 5 shows the optimal load flow result; the total reactive power losses are 19.53MVAR.

The power flows from send end bus to receiving buses are generally with limits apart from power flow from bus 1 to bus 2 where the loss load has reduced to 38.182 MW from base value of 43.143MW (a difference of 4.961MW).

Table 4

Newton Raphson Load flow Solution for GA-tuned TCSC	
Power-Loss (MW)	17.5
Reactive-Loss (MVAR)	19.53
Total System Load (MW)	283.4
Total Transfer Capability (MW)	245.22

4. OPF with IGWO-tuned UPFC

Optimization Results

Table 6 below show the optimization results for IGWO-tuned UPFC

Table 5: Optimization results

Parameter	Values
Voltage UPFC ()	1.04 1.05
Angle UPFC (R)	-1.08 -0.71
Location UPFC (Bus)	Bus 1 and Bus 8

Optimal NR Load Flow Solution for IGWO-tuned UPFC

Table 7 shows the optimal load flow result; the reactive power losses are 15.14MVAR.

The power flows from send end bus to receiving buses are generally with limits apart from power flow from bus 1 to bus 2 where the loss load has reduced to 41.353MW from base value of 43.143MW (a difference of 1.790MW).

Table 6: Newton Raphson Load flow Solution

Newton Raphson Load flow Solution	
Parameter	Values
Power-Loss (MW)	17.36
Reactive-Loss (MVAR)	15.14
Total System Load (MW)	283.4
Total Transfer Capability (MW)	242.05

5. OPF with IGWO-tuned TCSC

Optimization Results

Table 7 below show the optimization results for IGWO-tuned TCSC

Table 7: Optimization results

Parameter	Values
Reactance TCSC (PU) (p.u.)	0.015 and 0.0015
Location TCSC (Line)	Line 2 and Line 4

Optimal NR Load Flow Solution for IGWO-tuned TCSC

Table 9 shows the optimal load flow result, the total real power loss is 17.32MW, reactive power losses (17.62MVAR), TTC (246.11MW) and total system load remained unchanged at 283.4MW for the power flow with the application of IGWO-tuned TCSC FACTS controller. The power flows from send end bus to receiving buses are generally with limits apart from power flow from bus 1 to bus 2 where the loss load has reduced to 41.353MW from base value of 43.143MW (a difference of 1.7.743MW).

Table 8: Newton Raphson Load flow Solution

Newton Raphson Load flow Solution	
Parameter	Values
Power-Loss (MW)	17.32
Reactive-Loss (MVAR)	17.62
Total System Load (MW)	283.4
Total Transfer Capability (MW)	246.11

6. OPF with Hybrid MGA and IGWO-tuned UPFC

Optimization Results

Table 10 below show the optimization results for Hybrid MGA and IGWO-tuned UPFC

Table 9: Optimization results

Optimization Results	
Voltage UPFC (p.u.):	1.03 and 1
Angle UPFC (R) :	-0.51 and -0.65
Location UPFC (Bus):	Bus 30 and Bus 1

Optimal NR Load Flow Solution for Hybrid GA and IGWO-tuned UPFC

Table 11 shows the optimal load flow result, the total real power loss is 16.54 MW, reactive power losses (14.53MVAR), TTC (243.91MW) and total system load remained unchanged at 283.4MW for the power flow with the application of Hybrid MGA and IGWO-tuned UPFC FACTS controller. The power flows from send end bus to receiving buses are generally with limits apart from power flow from bus 1 to bus 2 where the loss load has reduced to 41.281MW from base value of 43.143MW (a difference of 1.6506MW).

Table 10: Newton Raphson Load flow Solution

Newton Raphson Load flow Solution	
Power-Loss (MW)	16.54
Reactive-Loss (MVAR)	14.53
Total System Load (MW)	283.4
Total Transfer Capability (MW)	243.91

7. OPF with Hybrid GA and IGWO-tuned TCSC

Optimization Results

Table 12 below show the optimization results for Hybrid MGA and IGWO-tuned TCSC

Table 11: Optimization results

Parameter	Values
Reactance TCSC (p.u.):	0.02 and 0.02
Location TCSC (Line):	Line 4 and Line 2

Optimal NR Load Flow Solution for Hybrid GA and IGWO-tuned TCSC

Table 13 below shows the optimal load flow result, the total real power loss is 17.52MW, reactive power losses (17.92 MVAR), TTC (250.8 MW) and total system load remained unchanged at 283.4MW for the power flow with the application of Hybrid GA and IGWO-tuned TCSC FACTS controller. The power flows from send end bus to receiving buses are generally with limits apart from power flow from bus 1 to bus 2 where the loss load has

reduced to 32.6 MW from base value of 43.143MW (a difference of 10.543MW).

Table 12: Newton Raphson Load flow Solution

Newton Raphson Load flow Solution	
Power-Loss (MW)	17.52
Reactive-Loss (MVAR)	17.92
Total System Load (MW)	283.4
Total Transfer Capability (MW)	250.8

IV. ASSESSMENT OF THE COMPARATIVE EFFECTS OF THE HYBRID OPTIMIZATION TECHNIQUE USING UPFC AND TCSC FACTS FOR REAL POWER LOSSES

The figure 14 below shows the real power for different optimization techniques

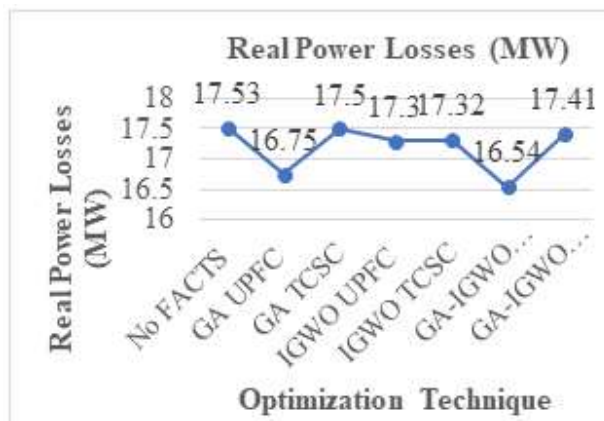


Figure 2: Real power for different optimization techniques

V. CONCLUSION

The novel Hybrid MGA and IGWO-tuned TCSC FACTS controller CPF solution for reduction of real power losses solution was 17.41MW, a reduction of 0.12MW from the base case solution. There was reduction of 0.99MW for the solution with Hybrid MGA and IGWO-tuned UPFC FACTS controller from the real power losses' base solution, a reduction of 0.21MW from IGWO-tuned TCSC FACTS controller from the real power losses' base case solution, a

reduction of 0.23MW from IGWO-tuned UPFC FACTS controller from the real power losses' base solution and a reduction of 0.03MW from MGA-tuned TCSC FACTS controller from the real power losses' base case solution. The reduction of real power loss with MGA-tuned UPFC FACTS controller from the base TTC solution was 0.78MW. This makes the real power losses' solution with hybrid MGA and IGWO with UPFC tuned FACTS controllers the most superior solution to all solution accomplished and tested in this research. It imperative to note that the hybrid technique has brought out the inherent strengths of the FACTS controllers applied. For reduction of real power losses, UPFC is more superior to TCSC for all scenarios. Hence for power system networks with real power losses' problems, UPFC is more recommended for application than TCSC. In addition, the performance of MGA with tuned UPFC FACTS controller (reduction of 0.78MW) optimization techniques has proven to be better than the IGWO with tuned UPFC FACTS controller (reduction of 0.78MW) for reduction of real power losses.

REFERENCES

1. A. Naganathan and V. Ranganathan, "Improving Voltage Stability of Power System by Optimal Location of FACTS Devices Using Bio-Inspired Algorithms", Circuits and Systems ISSN: 2153-1293, Volume-, Issue-6, May 2016
2. N. Kumar and K. Rosalina, "IPSO Algorithm for Maximization of System Loadability, Voltage Stability and Loss Minimization by Optimal DG Placement", International Journal of Innovative Research in Electrical, Electronics, Instrumentation and Control Engineering ISSN: 2321, Volume-3, Issue-11, May 2015
3. S. Saini and G. Kaur, "Optimal Placement and Sizing of Distributed Generation for Real Power Loss Reduction in Distribution Network", International Research Journal of Engineering and Technology ISSN: 2454- 2024, Volume 1 Issue 3, June 2016
4. M. Chakravorty and S. Patra, "Multi-Objective Teaching Learning Based Optimization Technique for Loss Reduction and Fast Voltage

- Stability Index Minimization", International Journal of Recent Technology and Engineering ISSN: 2395 -0056, Volume: 04 Issue: 04, April 2017
5. B. Bhattacharyya, V. Gupta and S. Kumar, "UPFC with series and shunt FACTS controllers for the economic operation of a power system", Ain Shams Engineering Journal ISSN: 775-778, May 2014
 6. E. Acha. R. Fuerte-Esquivel, and H. Ambriz-Perez et al., FACTS: Modeling and Simulation in Power Networks, London, U.K.: Wiley, 2004.
 7. K. Venkateswarlu, C. Babu, "Analysis and Enhancement of Transient Stability using Shunt Controlled FACTS Controller", International Journal of Engineering Sciences Research-IJESR, ISSN: 2230-8504; e-ISSN-2230-8512, Volume 1, Issue 02, May, 2011
 8. M. Abido, "Power System Stability enhancement using FACTS controllers: a review", The Arabian Journal for Science and Engineering, Volume 34, Number 1B, April 2009
 9. N. Mancor, B. Mahdad, K. Srairi and M. Hamed, "Multi Objective for Optimal Reactive Power Flow Using Modified PSO Considering TCSC", International Journal of Energy Engineering, 2(4): 165-170, 2012
 10. A. Lopez and L. Alonso, "Modeling and Stability Analysis of Berlin Geothermal Power Plant in El Salvador", Master's Thesis, University of Iceland Reykjavik, pp. 3-56, April 2013.
 11. C. Rajan, "A Hybrid Genetic Algorithm based on Differential Evolution Approach for Voltage Stability Improvement", International Journal of Computer Applications (0975 – 8887), Volume 86 – No 16, January 2014
 12. J. Manohar, A. Jinka and V. Rao, "Optimization of Loss Minimization Using FACTS in Deregulated Power Systems", Innovative Systems Design and Engineering ISSN 2222-2871, Volume 3, No 3, 2012
 13. S. Mirjalili, S. M. Mirjalili, A. Lewis, "Grey Wolf Optimizer, Advances in Engineering Software, vol. 69, pp.46-61, 2014
 14. H. Hassan and M. Zellagui, "Application of Grey Wolf Optimization Algorithm for Optimal Power Flow of Two-Terminal HVDC Transmission System", Journal of Power Engineering and Electrical Engineering, Volume 15: No: 2017
 15. Z. Wang, H. Xie Et al, "Node coverage optimization algorithm for wireless sensor networks based on Improved Grey wolf Optimization Algorithm", Journal of Algorithms & Computational Technology, Volume 13: pp.1–15,2019
 16. R. Sireesha, S. R. Coppisetty and M. V. Kumar, "Hybrid optimization to enhance power system reliability using GA, IGWO, and PSO", Paladyn, Journal of Behavioral Robotics; Volume 14: 20220119, 2023
 17. F. Ikule, A. Ame-Okro and E. Idoko, "load flow analysis using Newton-Raphson method, a case study of South-west Nigeria 330 kV network", International Journal of Advance Research and Innovative Ideas in Education, ISSN(O)-2395-4396, Vol-5 Issue-3, 2019
 18. Afolabi, O. A Et al., "Analysis of the Load Flow Problem in Power System Planning Studies. Energy and Power Engineering, vol.7, 509-523, 2015
 19. S. K. Goswami and S. K. Basu, "Direct solution of distribution systems," IEE Proc., pt. C, vol. 188, no. 1, pp. 78-88, 1999
 20. J. Glover and M. Sara, "2nd Power System Analysis and Design. 3rd Edition", Brooks/Cole, Pacific Grove. 2002
 21. D. Mander and G. Viridi, "Result Analysis on Load Flow by Using Newton Raphson Method", International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering, vol. 6, no. 7, pp. 5835-5844, 2017
 22. Y. Han, "Economic dispatching Optimization of power grid based on IGWO Algorithm", Journal of Physics: Conference Series, 1748 032009: doi:10.1088/1742-6596/1748/3/032009, 2021
 23. H. W. Reyad, M. Elfar and E. E. El-Araby, "Probabilistic Assessment of Available Transfer Capability Incorporating Load and Wind Power Uncertainties", IEEE Open Access Journal, Volume 11, April 2023
 24. M. Nadimi-Shahraki, S. Taghian and S. Mirjalili, "An Improved Grey Wolf Optimizer for Solving Engineering Problems", Expert Systems with Applications, Volume 166, March 2021